CITYTUNNEL BREGENZ / AUSTRIA
Municipal sector (ASFINAG)



COMPACT BASIN




SYSTEM H-C2

REQUIREMENTS:

- Highest level of reliability must be ensured even with high levels of dirt and dust
- deally a filterless system, as cleaning and maintenance of filters is difficult in decentralised systems
- In the event of a fire in the tunnel, large quantities of extinguishing water are produced, so the system needs to be dimensioned correctly

SOLUTION:

- Upstream installation of a filterless high-performance separator SYSTEM H-C2 NS 80 l/sec. upstream of the pollutant basin

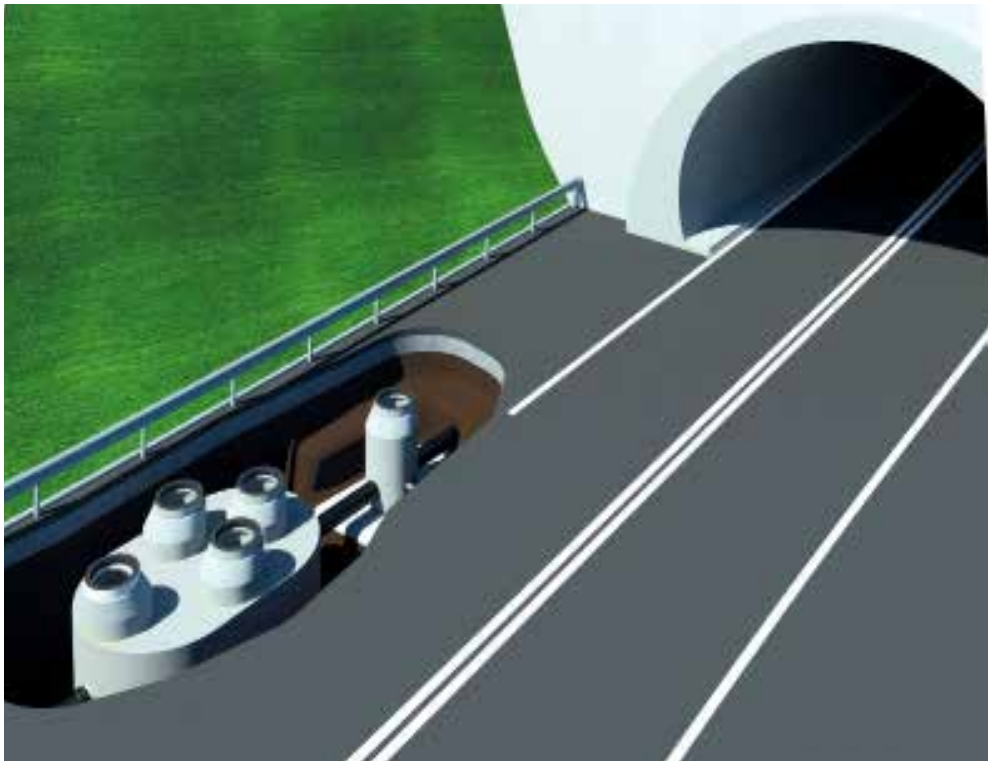

INOWA Abwassertechnologie GmbH
Tonstraße 5, A-4614 Marchtrenk
Tel: +43 (0) 72 43 514 14 - 0
www.inowa.at

INNOVATIV. SUCCESSFUL. SUSTAINABLE.

INOWA ABWASSERTECHNOLOGIE